



City of Chicago  
 Department of Public Health  
 333 South State Street, Room 200  
 Chicago, IL 60604  
 3127453162

**FOR OFFICE USE ONLY**  
 Facility # 2032952  
 Permit # 01424-2020INS  
 Request Rec'd 10/07/2020  
 Amended Date 06/15/2022 IL0  
 Approval Date 10/7/2020  
 Permit Expires 4/7/2023

**Extended/Amended**

**Permit for INSTALLATION of Underground Storage Tank(s) and Piping for Petroleum and Hazardous Substances.**

Permission to install underground storage tank(s) or piping is hereby granted. Such installation must be in complete accordance with acceptable materials as specified in the Federal Register, Part II Environmental Protection Agency, 40 CFR Parts 280 and 281, and also with all sections of 41 Illinois Administrative Code, Parts 174, 175 and 176. The contractor the permit was issued to or an employee of that contractor (this does not include a subcontractor) shall submit a required job schedule for installation of underground storage tank(s) to the Office of the State Fire Marshal, Division of Petroleum and Chemical Safety. **THIS PERMIT IS VALID FOR SIX MONTHS FROM THE APPROVAL DATE.**

|  |   |
|--|---|
| <p><b>(1) OWNER OF TANKS</b> - Corporation, partnership, or other business entity:</p> <p>Faust James<br/>         2500 W Higgins Rd<br/>         Hoffman Estates, IL 60195</p> <p>Contact: Faust James (708) 788-0200</p> | <p><b>(2) FACILITY</b> - name and address where tanks are located:</p> <p>Faust Inc DbA Abc Automotive Electronic<br/>         4755 W Grand<br/>         Chicago, IL 60639</p> <p>Contact: Faust James (708) 788-0200</p> |
|--|---|

**(3) INSTALLATION OF TANKS:**

- (a) *Number and size of tanks being installed: (TK # 3) - 15,000, (TK # 4, 5, 6) - 4,000*
- (b) *Type of tank(s): (TK # 3, 4, 5, 6) Tank - Composite Double Wall Glasteel II*
- (c) *Type of piping: (TK # 3, 4, 5, 6) Piping - Flexible Double Wall OPW Flexworks, (TK # 3, 4, 5, 6) Piping - Ball Valves, (TK # 3, 4, 5, 6) Piping - Shear Valves, (TK # 3, 4, 5, 6) Piping - Flex Connector Steel, (TK # 3, 4, 5, 6) Piping - Single Wall STP/Tanktop Sump*
- (d) *Product to be stored in each tank: (TK # 3) - Gasoline - Regular, (TK # 4) - Gasoline - Premium, (TK # 5) - Diesel Fuel, (TK # 6) - E-85*
- (e) *Type of leak detection being used:*
  - Tank: (TK # 3, 4, 5, 6) Leak Detect - Tank - Automatic Tank Gauging Veeder Root TLS 450 Plus with CSLD, (TK # 3, 4, 5, 6) Leak Detect - Tank - Non-Discriminating Interstitial Monitoring Sensors*
  - Piping: (TK # 3, 4, 5, 6) Leak Detect - Piping - Electronic Pressurized Line Leak Detection, (TK # 3, 4, 5, 6) Leak Detect - Piping - Non-Discriminating Sump Sensor with positive shutdown*
- (f) *Corrosion Protection being used:*
  - Tank: (TK # 3, 4, 5, 6) Corrosion Prot - Tank - Composite Non-Corrosive*
  - Piping: (TK # 3, 4, 5, 6) Corrosion Prot - Piping - Flexible Non-Corrosive*
- (g) *Spill containment devices, piping and dispenser containment devices: (TK # 3, 4, 5, 6) Spill Contain Device - Double Wall Spill Bucket*
- (h) *Overfill prevention devices: (TK # 3, 4, 5, 6) Overfill Prev Device - Overfill Drop Tube Valve*

(4) The owner must notify this Office when completion of tank installation has occurred, on the Notification for Underground Storage Tank Form and the licensed contractor must submit the required job schedule for installation to the OSFM prior to the work being performed. Both forms can be obtained at [www.sfm.illinois.gov](http://www.sfm.illinois.gov) by calling (217)785-1020.

(5) **GENERAL REQUIREMENTS** : There shall be a minimum of two manufactured slotted or perforated observation wells of at least 4 inches in diameter, installed in each new tank field of tanks larger than 1000 gallons and one well for tanks less than 1000 gallons. A water tight containment shall be installed under all dispensers and at submersible pumps. A hydrostatic test must be performed on all containments. All steel piping for vents, risers, and fills in contact with the ground, backfill, or water shall be dielectrically wrapped or coated. A positive shut off valve shall be installed on pressurized product lines, at the submersibles, or installed at the tank for all suction piping systems. Vent piping is required to be tested from tank to grade level. All steel flex connectors in contact with ground, backfill or water shall have corrosion protection.

**(6) SPECIAL CONTINGENCIES :**

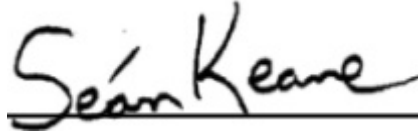
Amendment Reason: Sizing of tank #3 is incorrect. Permit says 12k on unleaded and its 15k. Eliminated one island Piping layout small changes

**(6) PERSON, FIRM OR COMPANY PERFORMING WORK:**

Anderson Pump Service, Inc.  
19659 South 97th Avenue  
Mokena, IL 60448

Contact Person: Hoyt Ary  
Phone: (708) 478-6190  
Contractor Registration # IL002275 Exp. 5/21/2022

Sincerely,

A handwritten signature in black ink that reads "Sean Keane". The signature is written in a cursive style and is positioned above a solid horizontal line.

Raul Valdivia

cc: Storage Tank Safety Specialist  
Division File