



City of Chicago
Department of Public Health
 333 South State Street, Room 200
 Chicago, IL 60604
 3127453152

FOR OFFICE USE ONLY
Facility # 2037219
Permit # 01747-2018INS
Request Rec'd 11/08/2018
Amended Date
Approval Date 11/13/2018
Permit Expires 5/14/2019

Permit for INSTALLATION of Underground Storage Tank(s) and Piping for Petroleum and Hazardous Substances.

Permission to install underground storage tank(s) or piping is hereby granted. Such installation must be in complete accordance with acceptable materials as specified in the Federal Register, Part II Environmental Protection Agency, 40 CFR Parts 280 and 281, and also with all sections of 41 Illinois Administrative Code, Parts 174, 175 and 176. The contractor the permit was issued to or an employee of that contractor (this does not include a subcontractor) shall submit a required job schedule for installation of underground storage tank(s) to the Office of the State Fire Marshal, Division of Petroleum and Chemical Safety. **THIS PERMIT IS VALID FOR SIX MONTHS FROM THE APPROVAL DATE.**

<p>(1) OWNER OF TANKS - Corporation, partnership, or other business entity:</p> <p>Trinity Hospital Advocate 2320 E 93rd St Chicago, IL 60617</p> <p>Contact: Bender Jerry (773) 978-2000</p>	<p>(2) FACILITY - name and address where tanks are located:</p> <p>Trinity Hospital Advocate 2320 E. 93rd Street Chicago, IL 60617</p> <p>Contact: Matthew Frase (773) 978-2000</p>
--	--

(3) INSTALLATION OF TANKS:

- (a) Number and size of tanks being installed: (TK # 3) - 8,000*
- (b) Type of tank(s): (TK # 3) Tank - Composite Double Wall Glasteel II*
- (c) Type of piping: (TK # 3) Piping - Fiberglass Double Wall A.O. Smith*
- (d) Product to be stored in each tank: (TK # 3) - Diesel Fuel*
- (e) Type of leak detection being used:*
 - Tank: (TK # 3) Leak Detect - Tank - Interstitial Monitoring OPW Site Sentinel I-Touch*
 - Piping: (TK # 3) Leak Detect - Piping - European with No Test Req Suction*
- (f) Corrosion Protection being used:*
 - Tank: (TK # 3) Corrosion Prot - Tank - Jacketed Steel Non-Corrosive*
 - Piping: (TK # 3) Corrosion Prot - Piping - Fiberglass Non-Corrosive*
- (g) Spill containment devices, piping and dispenser containment devices: (TK # 3) Spill Contain Device - Single Wall Spill Bucket EBW 705*
- (h) Overfill prevention devices: (TK # 3) Overfill Prev Device - Overfill Drop Tube Valve OPW 71SO-4000*

(4) The owner must notify this Office when completion of tank installation has occurred, on the Notification for Underground Storage Tank Form and the licensed contractor must submit the required job schedule for installation to the OSFM prior to the work being performed. Both forms can be obtained at www.sfm.illinois.gov or by calling (217)785-1020.

(5) GENERAL REQUIREMENTS : There shall be a minimum of two manufactured slotted or perforated observation wells of at least 4 inches in diameter, installed in each new tank field of tanks larger than 1000 gallons and one well for tanks less than 1000 gallons. A water tight containment shall be installed under all dispensers and at submersible pumps. A hydrostatic test must be performed on all containments. All steel piping for vents, risers, and fills in contact with the ground, backfill, or water shall be dielectrically wrapped or coated. A positive shut off valve shall be installed on pressurized product lines, at the submersibles, or installed at the tank for all suction piping systems. Vent piping is required to be tested from tank to grade level. All steel flex connectors in contact with ground, backfill or water shall have corrosion protection.


(6) SPECIAL CONTINGENCIES :

(6) PERSON, FIRM OR COMPANY PERFORMING WORK:

Metro Environmental Contractors, Inc. dba Metro Tank & Pump
Company
1111 West Dundee Road
Wheeling, IL 600903936

Contact Person: Warren Cherner
Phone: (847) 465-4000
Contractor Registration # IL102 Exp. 2/7/2020

Sincerely,

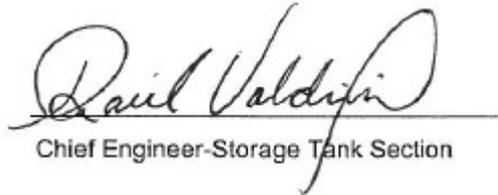

Chief Engineer-Storage Tank Section

Raul Valdivia

cc: Storage Tank Safety Specialist
Division File