
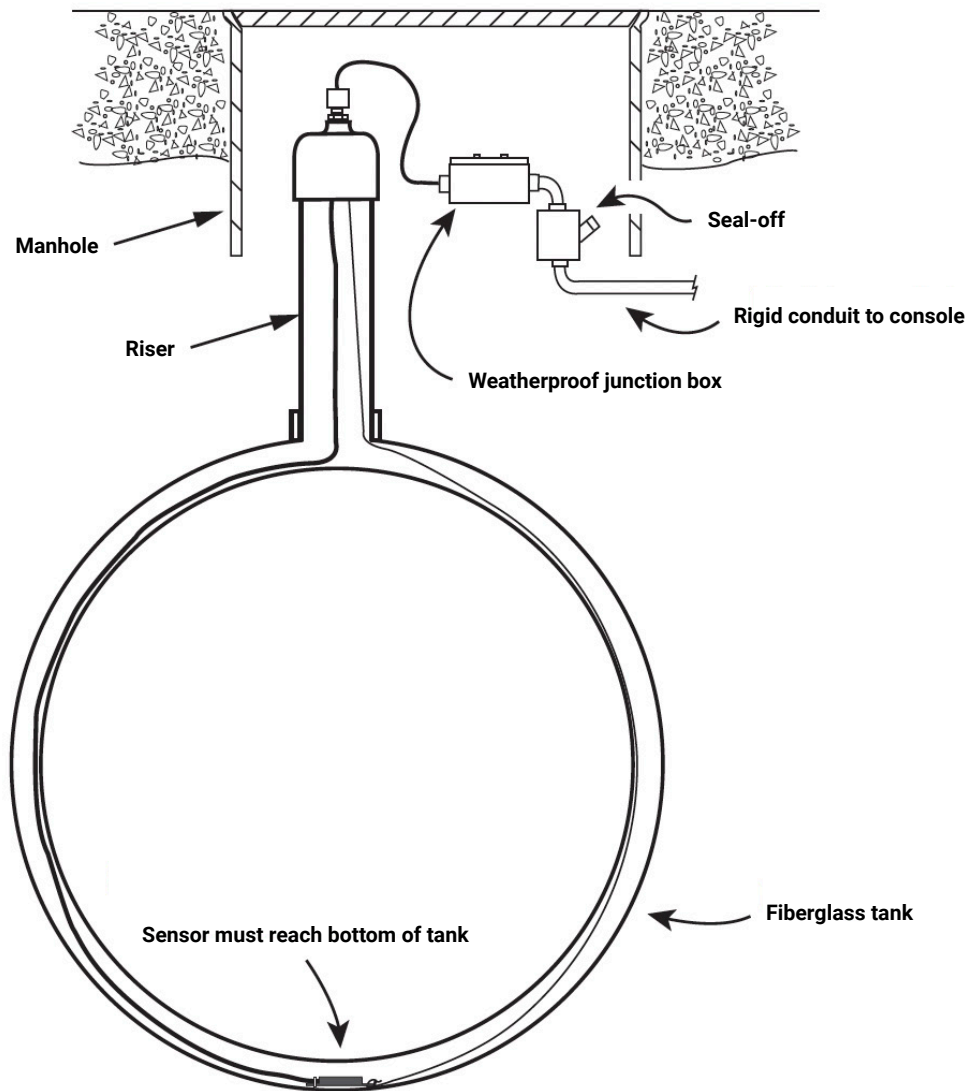


<b>Sensor Description</b>	<b>Interstitial Sensor for Double-Wall Fiberglass Tanks</b>		The Non-Discriminating Interstitial Sensor for Double-Wall Fiber-Glass Tanks detects the presence of liquid in the interstitial space of the tank.				
<b>Part Number</b>	<b>0794390-409</b>						
<b>Category</b>	<input type="checkbox"/> Discriminating <input checked="" type="checkbox"/> Non-Discriminating <input type="checkbox"/> Position Sensitive		<input type="checkbox"/> Level Sensing <input type="checkbox"/> Static Testing <input type="checkbox"/> Hydrostatic				
<b>Fuel Compatibility</b>	<input checked="" type="checkbox"/> Gas <input checked="" type="checkbox"/> Diesel <input checked="" type="checkbox"/> Kerosene <input checked="" type="checkbox"/> Jet Fuel <input checked="" type="checkbox"/> Aviation Gas		<input checked="" type="checkbox"/> E-15 <input type="checkbox"/> E-85 <sup>1</sup> <input type="checkbox"/> E-100 <input checked="" type="checkbox"/> Bio-Diesel 20 <input type="checkbox"/> Bio-Diesel 100				<input checked="" type="checkbox"/> Green Diesel <input type="checkbox"/> DEF <input checked="" type="checkbox"/> Waste Oil <input checked="" type="checkbox"/> Motor Oil
<b>Console Compatibility</b>	<b>Recommended Min. Console Software</b>	<b>Sensor Interface Modules</b>					
		<b>Module Part #</b>	<b>Module Description</b>	<b># of Modules per Console</b>	<b># of Sensor Inputs per Module</b>	<b>Availability</b>	
TLS-450PLUS (8600 Series)	6.A or Higher	0332812-001	Universal Sensor Module (USM)	Up to 4 – TLS-4xx Up to 8 – TLS-4xx w/ opt. TLS-XB	16	Sold Separately	
TLS-450	4.A or Higher						
TLS4 (8601 Series)	6.A or Higher	0330020-750	Universal Sensor Input/Output Module (USIOM-AC)	1	12	Included	
TLS4i (8601 Series)		0330020-751			6		
TLS4B (8601 Series)					8		8
TLS4c (8601 Series)							4
TLS-350/R/PLUS	124/324 or Higher	0329358-001	Interstitial Sensor Interface Module	Up to 8	8	Sold Separately	
TLS-350J		0329356-003	4 Probe / 4 Sensor Interface Module	1	4	Sold Separately	
TLS-300i		0330230-001	4 Probe / 8 Sensor Interface Module		8	Included	
<b>Alarm Notification</b>	Normal	Sensor in Normal State – No liquid detected					
	Liquid Alarm	Liquid detected					
	Sensor Out	Sensor not communicating to ATG/Console					
<b>Specifications</b>							
Operating Principle	Reed Switch / Float						
Product Activation Height	0.28" (0.71cm)						
Operating Temperature	-4°F to +140°F (-20°C to +60°C)						
Dimensions	2.2" (5.6cm) length, 1.3" (3.3cm) width, 0.6" (1.5cm) thick						
Miscellaneous/Notes	Standard Cable Length: 25' (7.6m), fits 4' to 10' (1.2m to 3m) I.D. fiberglass tanks						
Third Party Evaluation Links	<a href="#">TLS-3XX/TLS-450 Series Consoles</a> <a href="#">TLS4 (8601 Series) Consoles</a>						
Product Link	<a href="#">Non-Discriminating Interstitial Sensor</a>						
Warranty with System	1 Year Parts & Lab						
Warranty (When purchased separately)	1 Year Parts Only						

**Where Used (Typical)**

- |  |   |
|--|---|
| <input type="checkbox"/> Dispenser Pan     | <input checked="" type="checkbox"/> Annular Space |
| <input type="checkbox"/> Spill Containment | <input type="checkbox"/> Monitoring Well          |
| <input type="checkbox"/> STP Sump          | <input type="checkbox"/> Oil/Water Separator Tank |
| <input type="checkbox"/> Convault Tank     |   |

**Example Installation**


# Notice

---

Veeder-Root makes no warranty of any kind with regard to this publication, including, but not limited to, the implied warranties of merchantability and fitness for a particular purpose.

**Veeder-Root shall not be liable for errors contained herein or for incidental or consequential damages in connection with the furnishing, performance, or use of this publication.**

Veeder-Root reserves the right to change system options or features, or the information contained in this publication.

This publication contains proprietary information which is protected by copyright. All rights reserved. No part of this publication may be photocopied, reproduced, or translated to another language without the prior written consent of Veeder-Root.

## **Example Illustrations**

Illustrations used in this guide for example sensor installations may contain components that are customer supplied and not included with the sensor. Please check with your Veeder-Root Distributor for recommended installation accessories.

## **Third Party Evaluations**

Third party evaluations of the Veeder-Root sensors contained in this application guide can be found under the Veeder-Root vendor name on the National Work Group on Leak Detection Evaluations (NWGLDE) website: <http://www.nwglde.org>